

Chih-I Wu  
01 Aug 2025



**ROOM**  
2025/8/1 08:52:34

## Device

|                |                |                  |
|----------------|----------------|------------------|
| Type of device | Serial n°      | Software version |
| KH 50          | OK 16.12.12003 | 1.06             |


## Dataset parameters

|                   |                   |
|-------------------|-------------------|
| Dataset name      | Type of dataset   |
| ROOM              | Instant           |
| Number of points  | Interval          |
| 2978              | 15 minute(s)      |
| Start date        | End date          |
| 2025/7/1 08:35:00 | 2025/8/1 08:50:00 |
| Comments          |                   |

## Channels

|               |                |                      |
|---------------|----------------|----------------------|
| Channel       | Measure        | Probe                |
| Ch-int1 [°C]  | Temperature    | Ambient thermo-hygro |
| Low threshold | High threshold |                      |
| 15.0          | 25.0           |                      |
| Minimum       | Maximum        | Average              |
| 20.9          | 22.0           | 21.21                |
|               |                | Standard             |
|               |                | 0.13                 |
|               |                | MKT                  |
|               |                | 21.21                |

|               |                |                      |
|---------------|----------------|----------------------|
| Channel       | Measure        | Probe                |
| Ch-int2 [%RH] | Hygrometry     | Ambient thermo-hygro |
| Low threshold | High threshold |                      |
| —             | —              |                      |
| Minimum       | Maximum        | Average              |
| 62.4          | 64.5           | 63.54                |
|               |                | Standard             |
|               |                | 0.30                 |
|               |                | MKT                  |
|               |                | 0.00                 |

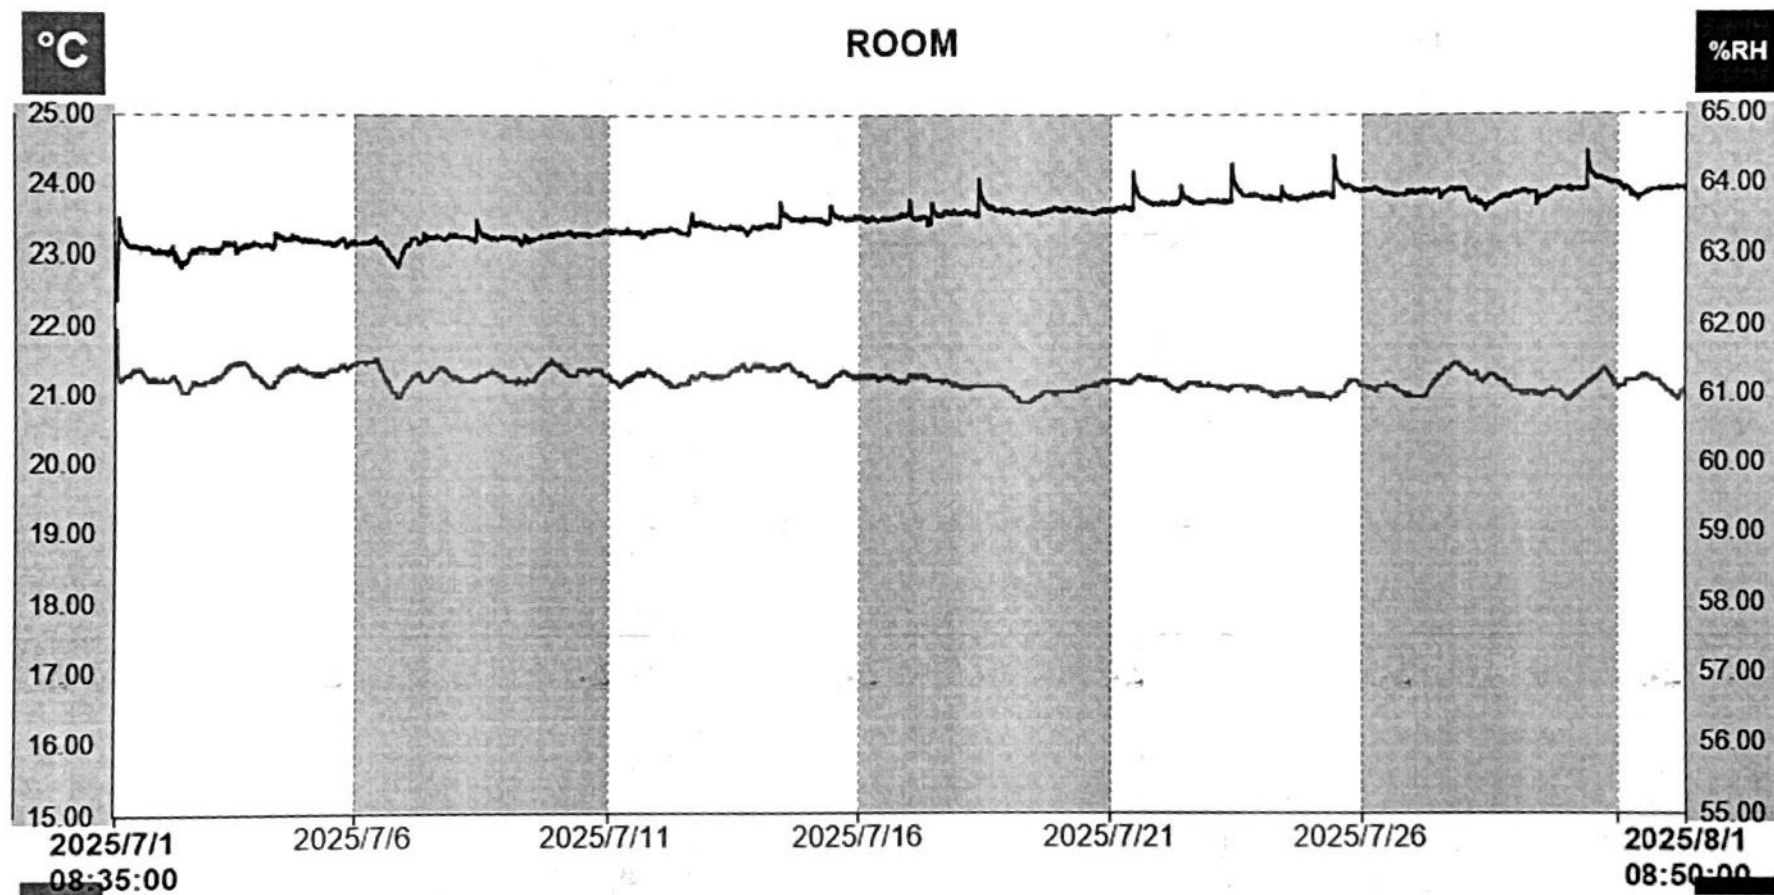

|                               | Number of<br>points | Minimum | Maximum | Average | Standard<br>deviation | MKT   |
|-------------------------------|---------------------|---------|---------|---------|-----------------------|-------|
| <b>KH 50 [OK 16.12.12003]</b> |                     |         |         |         |                       |       |
| Ch-int1 [°C]                  | 2978                | 20.9    | 22.0    | 21.21   | 0.13                  | 21.21 |
| Ch-int2 [%RH]                 | 2978                | 62.4    | 64.5    | 63.54   | 0.30                  | —     |