



ROOM
2025/12/1 10:11:31

Device

Type of device KH 50	Serial n° OK 16.12.12003	Software version 1.06
-------------------------	-----------------------------	--------------------------

Dataset parameters


Dataset name ROOM	Type of dataset Instant
Number of points 5858	Interval 15 minute(s)
Start date 2025/10/1 09:45:00	End date 2025/12/1 10:00:00

Comments

Channels

Channel Ch-int1 [°C]	Measure Temperature	Probe Ambient thermo-hygro		
Low threshold 15.0	High threshold 25.0			
Minimum 20.9	Maximum 22.8	Average 21.43	Standard 0.16	MKT 21.44

Channel Ch-int2 [%RH]	Measure Hygrometry	Probe Ambient thermo-hygro		
Low threshold ---	High threshold ---			
Minimum 62.6	Maximum 65.9	Average 65.26	Standard 0.17	MKT 0.00

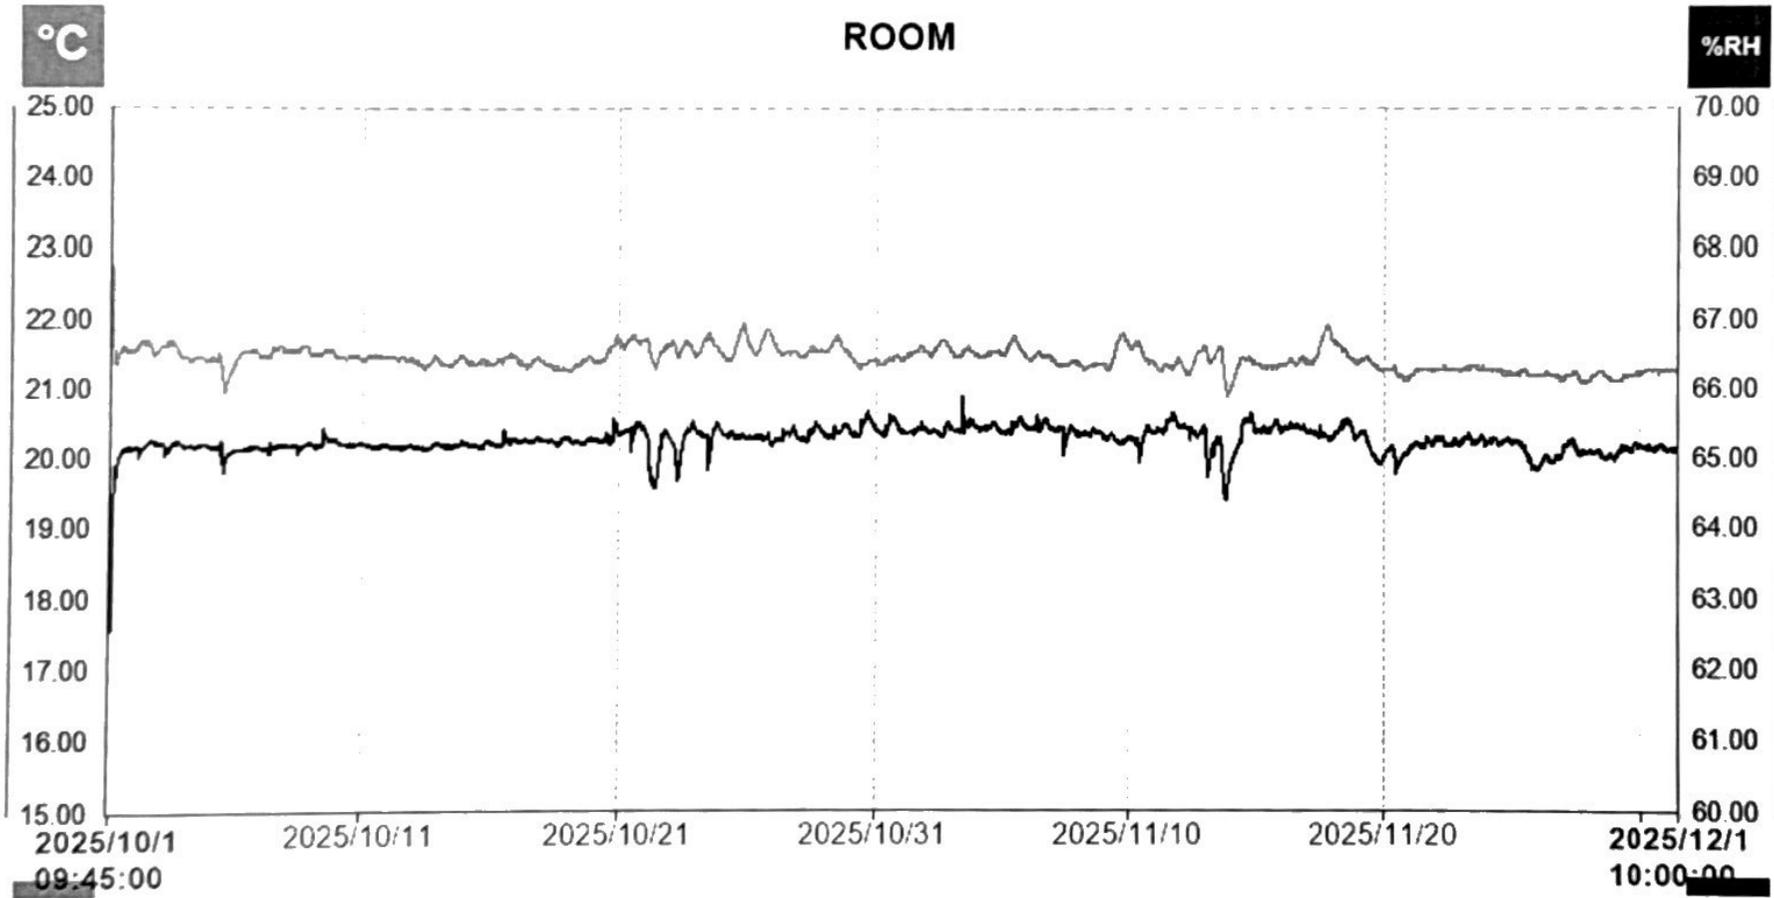



ROOM
2025/12/1 10:11:31

	Number of points	Minimum	Maximum	Average	Standard deviation	MKT
KH 50 [OK 16.12.12003]						
Ch-int1 [°C]	5858	20.9	22.8	21.43	0.16	21.44
Ch-int2 [%RH]	5858	62.6	65.9	65.26	0.17	—